


# TEMPORARY SERVICE ASSEMBLY GUIDE

Treated service pole furnished and installed by customer.  
6" x 6" x 16' minimum, continuous single structure.

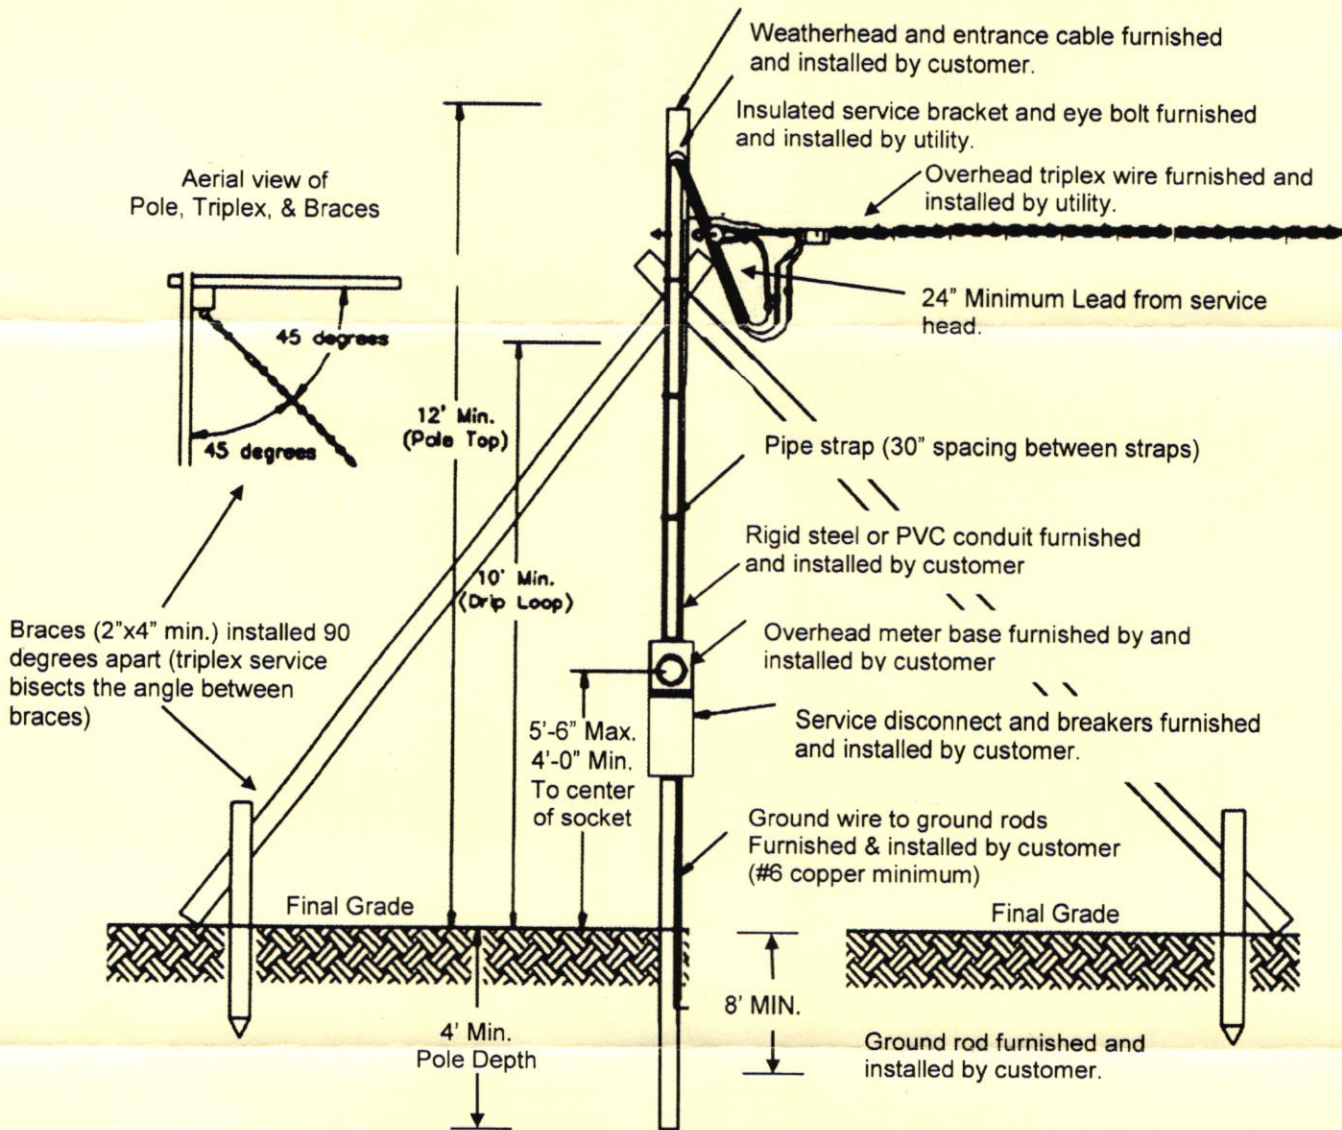

**Notes:**

1. All clearances to be in conformance to the most stringent requirements of either the NESC, NEC or other codes of governmental or regulating authorities as applicable.
2. If length of conduit exceeds 10 feet, coupling is permitted on and adjacent to meter.
3. Service pole location should always be spotted by Dayton Electric prior to installation.
4. Consult with a licensed electrician for conformance to the National Electrical Code (NEC) and local codes, and for proper sizing and installation of conductors and equipment.
5. Electrical inspections are required after wiring is completed and before meter is set.