

TYPICAL 320 AMP OR LESS OVERHEAD SERVICE INSTALLATION


COMPANY WILL FURNISH AND INSTALL SERVICE DROP AND BRACKET AND ATTACH TO SERVICE ENTRANCE.

MAST SHALL BE FULL SECTION OF PIPE WITH COUPLING LOCATED NEAR METER SOCKET. ONLY POWER SERVICE DROP CONDUCTORS SHALL BE PERMITTED TO BE ATTACHED TO MAST.

APPROVED CONDUIT STRAPS.

GALVANIZED RIGID CONDUIT OR IMC **ONLY**. IF EXTENSION ABOVE ROOF TO ATTACHMENT POINT IS:
 18" - 34" USE 2" DIAM. MIN.
 24" - 48" USE 2 1/2" DIAM. MIN.
 3" DIAM. MINIMUM FOR 320 AMP.

METER SOCKET* SHALL NOT BE RECESSED INTO WALL. COMPANY WILL FURNISH AND INSTALL METER.

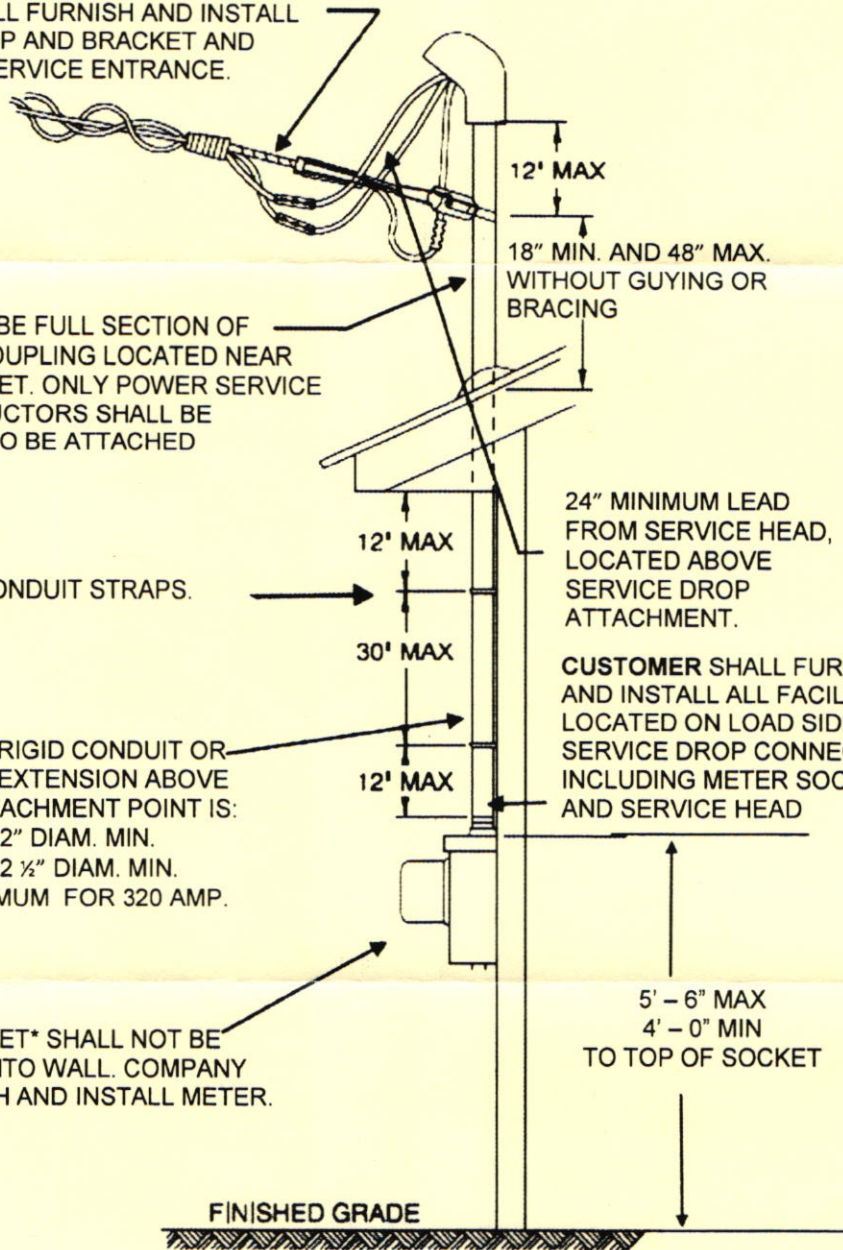

24" MINIMUM LEAD FROM SERVICE HEAD, LOCATED ABOVE SERVICE DROP ATTACHMENT.

CUSTOMER SHALL FURNISH AND INSTALL ALL FACILITIES LOCATED ON LOAD SIDE OF SERVICE DROP CONNECTORS INCLUDING METER SOCKET AND SERVICE HEAD

5' - 6" MAX
 4' - 0" MIN
 TO TOP OF SOCKET

NOTES:

1. **CUSTOMER** SHALL CONSULT COMPANY FOR POINT OF ATTACHMENT OF SERVICE DROP AND METER LOCATION. IF COMPANY AGREES TO ALLOW CUSTOMER TO INSTALL BRACKET ABOVE SERVICE HEAD, BRACKET SHALL BE LOCATED NO MORE THAN 24 INCHES FROM SERVICE HEAD.
2. **INHIBITOR COMPOUND** SHALL BE USED ON ALL ALUMINUM WIRE TERMINATIONS.
3. ALL **CUSTOMER** WORK SHALL BE COMPLETE AND INSPECTIONS OBTAINED BEFORE COMPANY WILL PROVIDE SERVICE.